


- A. HYDRANTS TO BE MUELLER 5 1/4" MVO SUPER CENTURION (YELLOW) 250
- B. JOINTS TO BE RESTRAINED BY GRIPS RING GASKETS OR BY USING FLANGE HYDRANT SHOE, GATE VALVE AND SPOOL.

1. ALL FITTINGS IN CONTACT W/CONCRETE SHALL BE WRAPPED IN PLASTIC. HYDRANT DRAIN HOLES TO REMAIN OPEN TO DRAIN ROCK AND OPERATIONAL.
2. 1 1/2" - 3/4" CLEAN DRAIN ROCK SHALL BE PLACED A MIN. OF 6" ABOVE DRAIN OUTLET.
3. BURY OF HYDRANT SHALL BE MEASURED FROM FINISHED GRADE TO BOTTOM OF CONNECTING PIPE
4. ALL CONNECTIONS SHALL BE MECHANICALLY RESTRAINED AND THRUST BLOCKED. THRUST BLOCK SHALL BE SIZED AS PER ODOT STANDARD DETAILS.
5. HYDRANT VALVE SHALL BE MUELLER RESILIENT SEAT GATE VALVE ONLY.

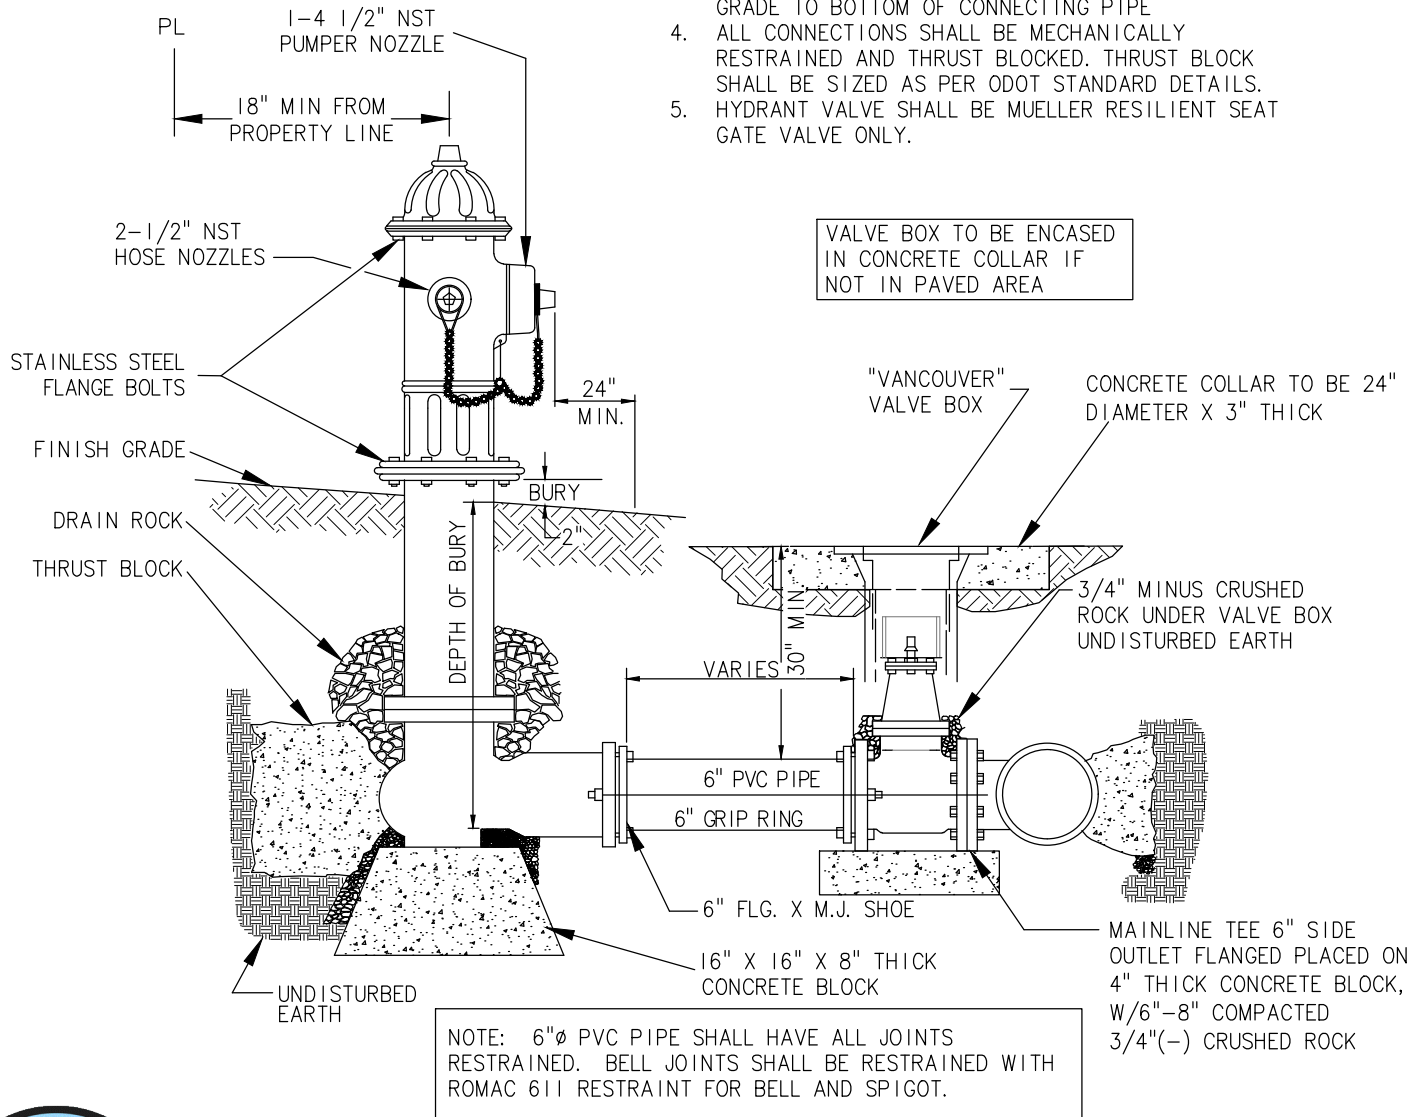

CITY OF MANZANITA
STANDARD CONSTRUCTION DRAWINGS

FIRE HYDRANT DETAIL

SCALE N.T.S.

DATE AUGUST 2025

APPR. R.REMPFER - PWD

DWG. FIRE HYDRANT DETAIL

DRAWN KKA
ENGR. NC CIVIL
REV. DATE APPR.