


1. CRUSHED ROCK BASE AND BACKFILL SHALL BE COMPACTED WITH VIBRATORY PLATE AND INSPECTED BY THE ENGINEER PRIOR TO FINAL PAVING. VALVE BOXES PLACED BELOW ADJACENT FINISH GRADE WILL NOT BE ACCEPTED.
2. VALVE BOXES SHALL BE PLUMB & CENTERED DIRECTLY OVER THE VALVE NUT IN A VERTICAL POSITION.

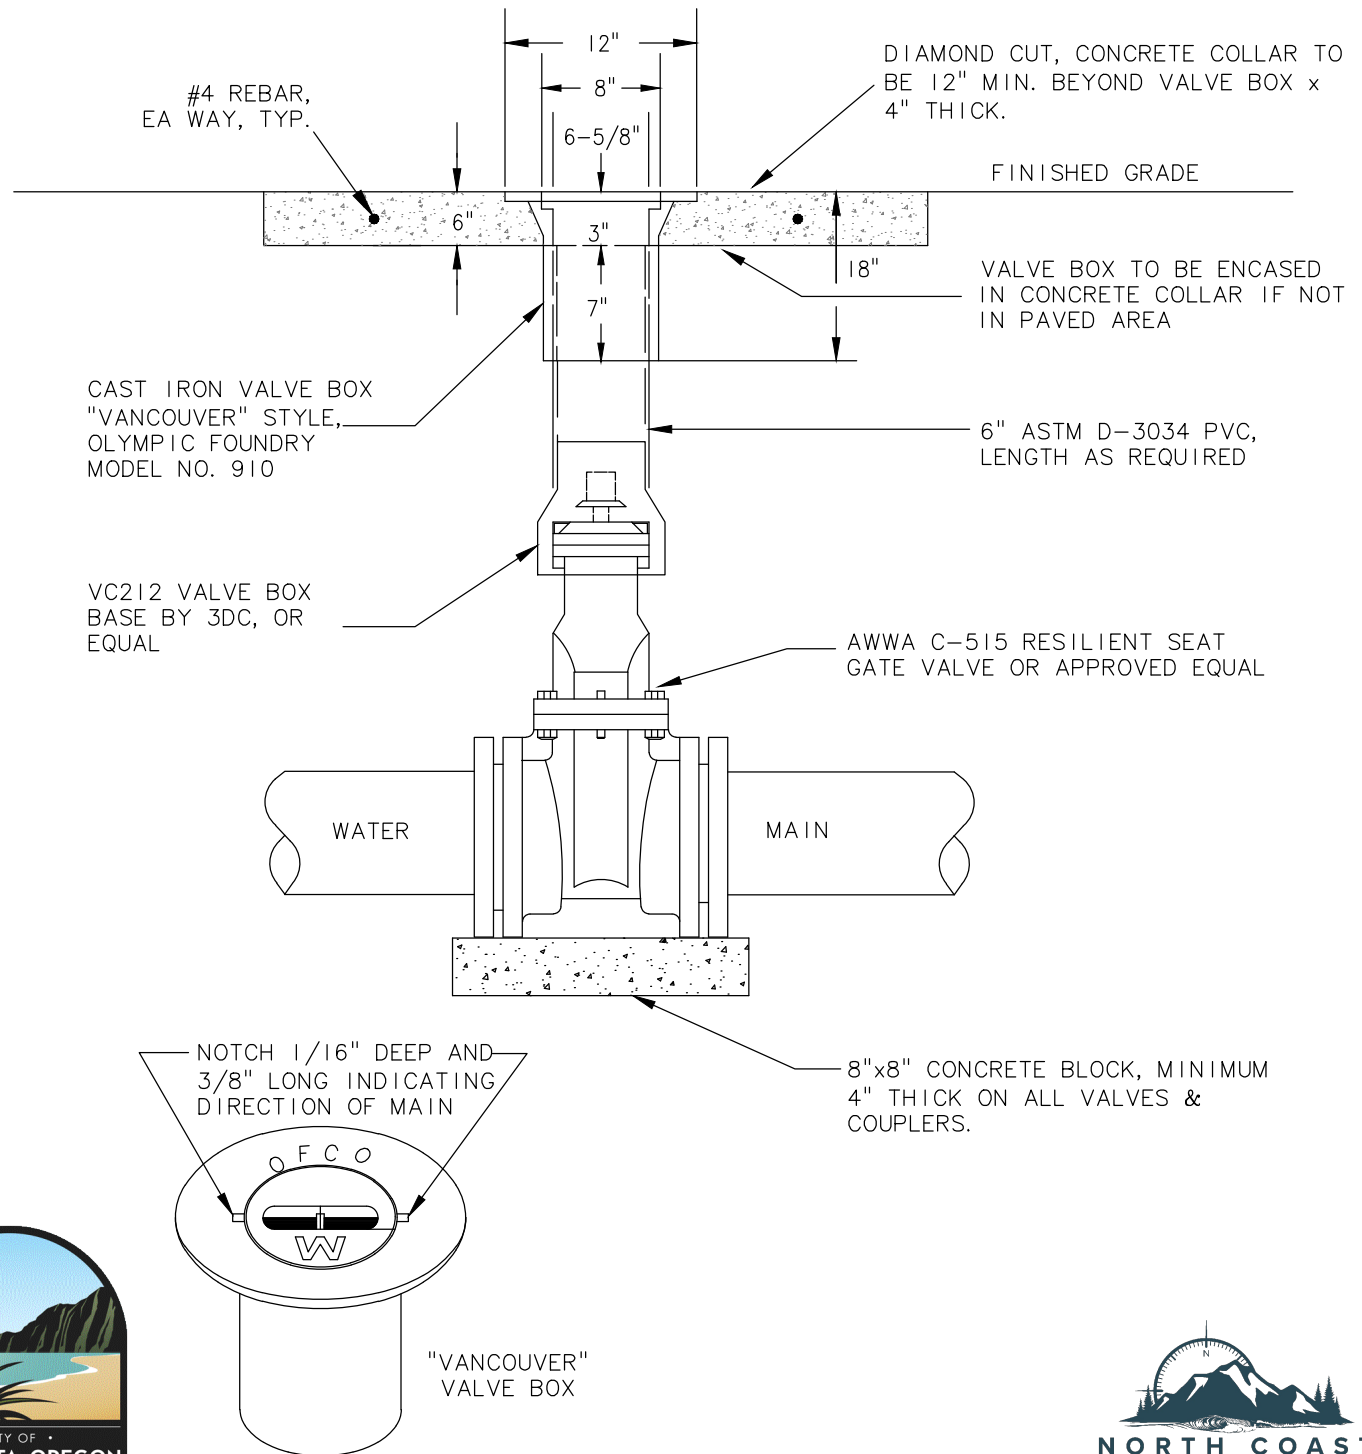

CITY OF MANZANITA
STANDARD CONSTRUCTION DRAWINGS

WATER VALVE DETAIL

SCALE N.T.S.

DATE AUGUST 2025

APPR. R.REMPFER - PWD

DWG. WATER VALVE DETAIL

DRAWN	KA
ENGR.	NC CIVIL
REV.	DATE APPR.