
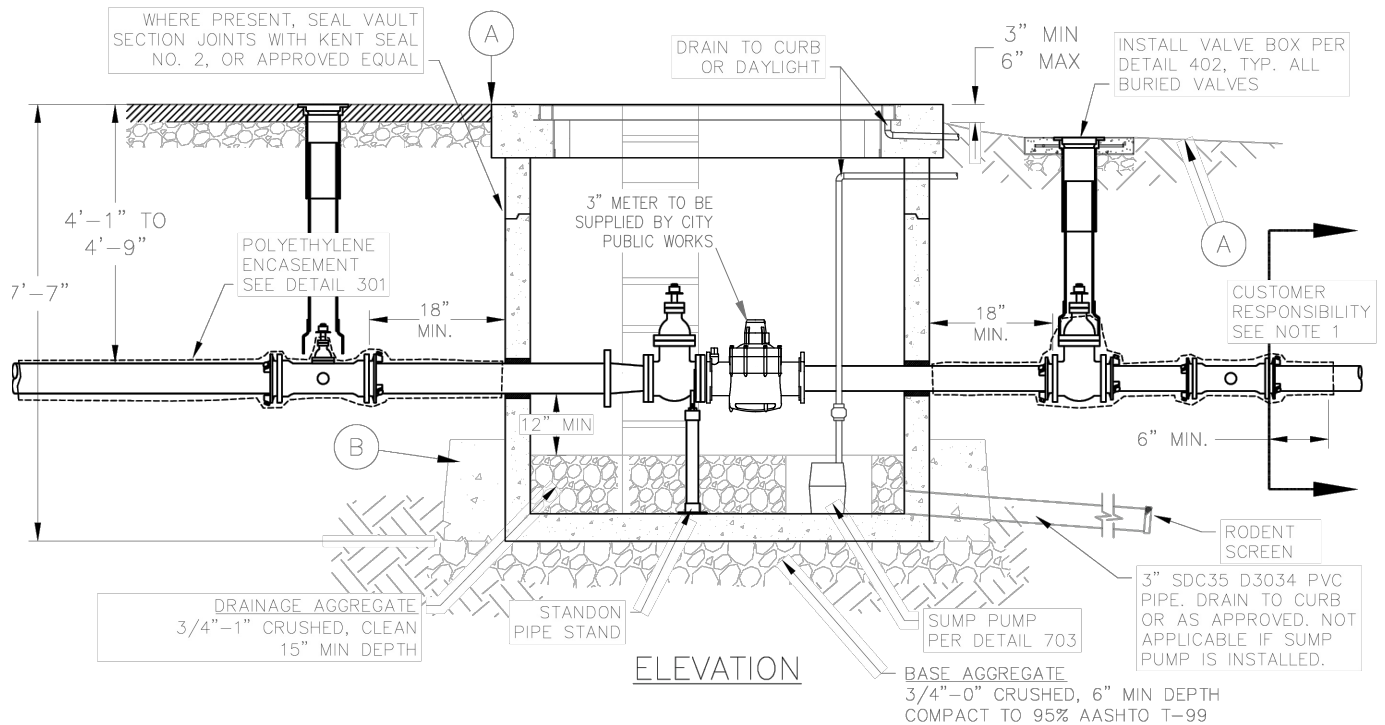


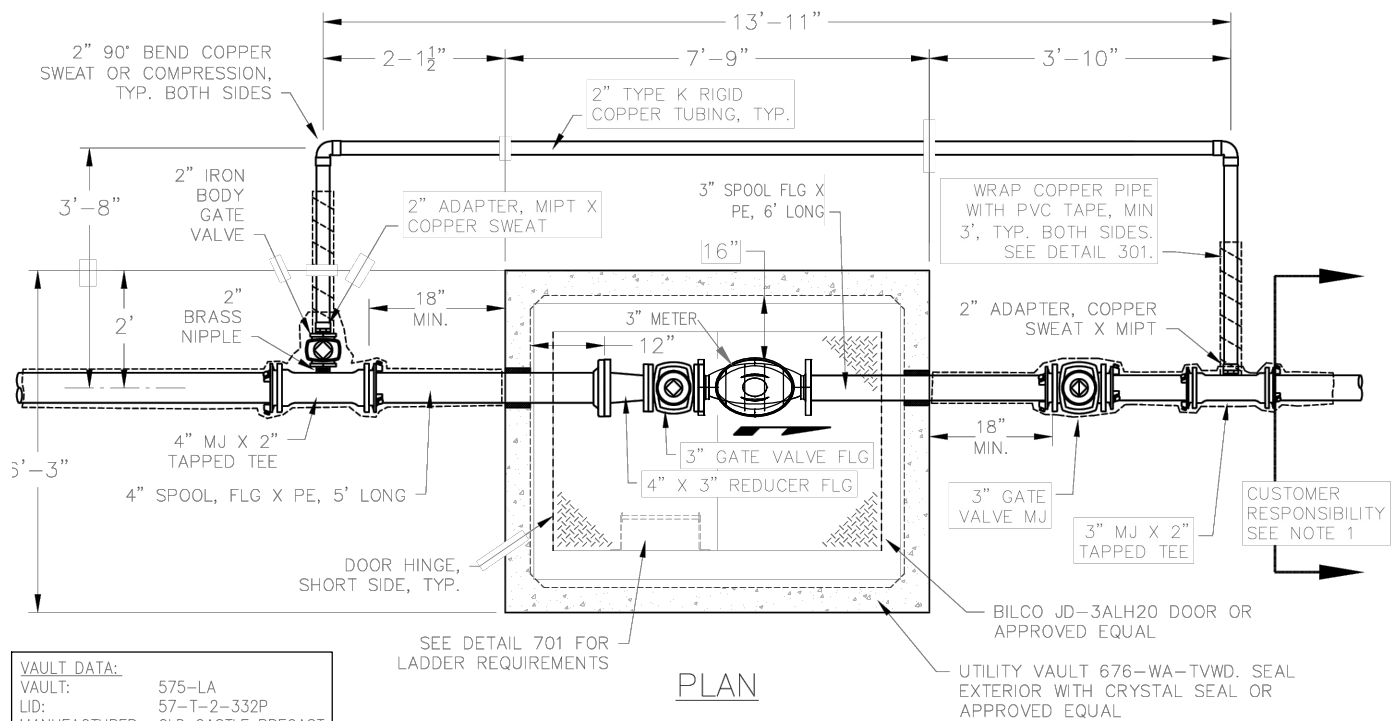

NOTES:

1. CUSTOMER OWNERSHIP AND MAINTENANCE RESPONSIBILITY BEGINS DIRECTLY DOWNSTREAM OF 3" X 2" TEE.
2. CONTRACTOR TO SEAL ALL OPENINGS IN VAULT WITH NON-SHRINK GROUT.
3. ORS 92.044(7) PROHIBITS LOCATING ANY UTILITY INFRASTRUCTURE WITHIN 1-FT. OF A SURVEY MONUMENT. DEVELOPER SHALL PAY FOR ANY RELOCATION OF SERVICES AND/OR METER BOXES FOUND TO FALL WITHIN 1-FT. OF A SURVEY MONUMENT LOCATION.

KEYNOTES:

- A. IN LANDSCAPED AREAS, GRADE SHALL SLOPE AWAY FROM VAULT. IN PAVED AREAS, GRADE SHALL BE FLUSH WITH TOP OF VAULT LID.
- B. CONTRACTOR TO INSTALL 3 CU YD MIN CONCRETE BALLAST AROUND BASE OF VAULT IN AREAS WHERE FLOODING OR HIGH GROUND WATER EXISTS.



CITY OF MANZANITA STANDARD CONSTRUCTION DRAWINGS

3" WATER METER DETAIL

DETAIL PER TVWD STANDARD DETAILS
 (SEE TVWD DETAILS FOR REFERENCE DETAILS (301, 402, 701, 703))

SCALE N.T.S.

DATE SEPTEMBER 2025

APPR. R.REMPFER - PWD

DWG. WATER SVC DETAIL

DRAWN KA
 ENGR. NC CIVIL
 REV. DATE APPR.